



180008221885



中国认可

报告编号: WM20-0146

Reference No.

TESTING

CNAS L1145

检测报告

Test Report

产品名称: 智能控制柜
Name of products

型 号: —
Type

委托人: 上海威派格智慧水务股份有限公司
Client

检测类别: 委托检验
Kind of test



上海电器设备检测所有限公司

SHANGHAI TESTING & INSPECTION INSTITUTE
FOR ELECTRICAL EQUIPMENT CO. LTD.


产品名称	智能控制柜		商 标	—	
型 号	—				
技术参数	—				
检测类别	委托检验				
委托人	上海威派格智慧水务股份有限公司		地 址	上海市嘉定区外冈镇恒定路 1 号	
生产者	上海威派格智慧水务股份有限公司		地 址	上海市嘉定区外冈镇恒定路 1 号	
送样数量	1	送样者	—	产品编号	—
抽样地点	—	抽样者	—	抽样数量/ 抽样基数	—
抽样日期	—		到样日期	2020 年 04 月 08 日	
样品编号	#01				
检测依据	1. GB/T 4208-2017 《外壳防护等级 (IP 代码)》				
判定依据	—				
检测日期	2020 年 04 月 16 日				
检测结论	根据委托方要求, 该样品按 GB4208-2017 进行检验, 检验结果符合 IP66 要求。 。 签发日期 2020 年 4 月 17 日				
备注	—				

批准 邵明

审核 邵明

编制 邵明

样品照片

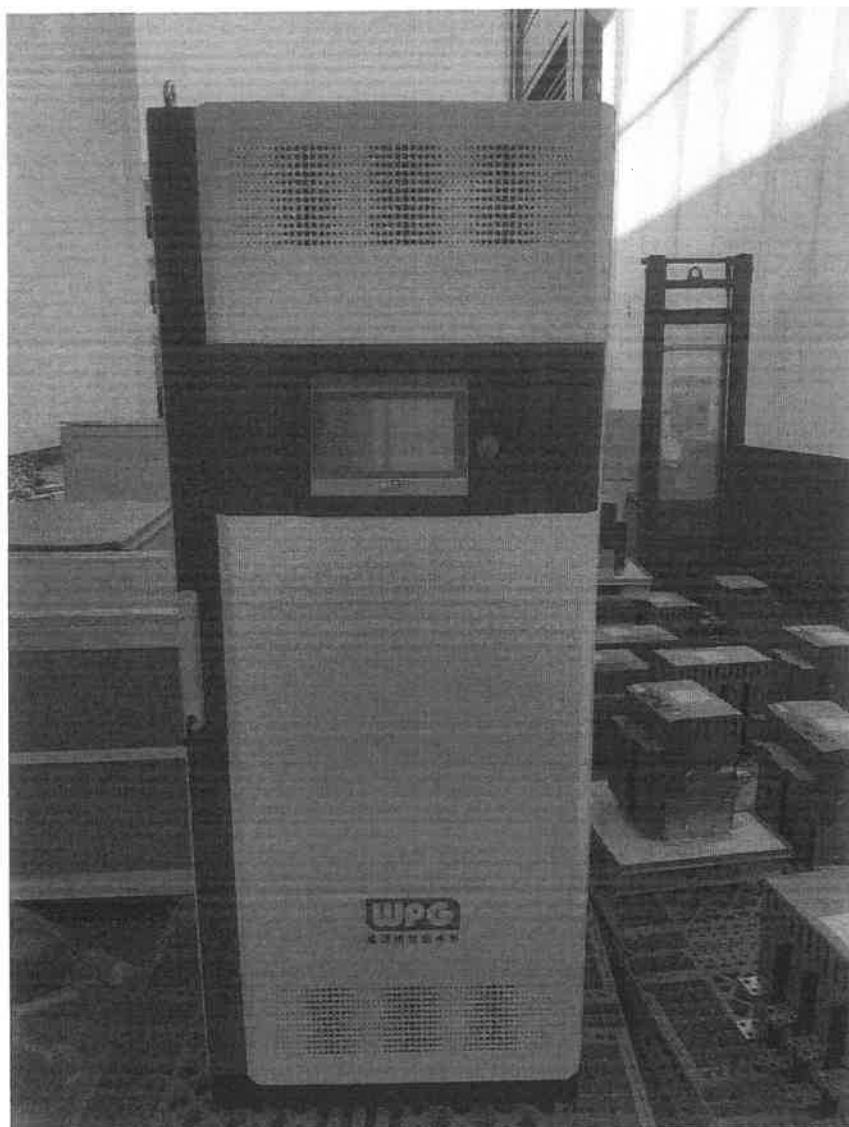

序 号	检测项目及检测要求	测量或观察结果	判 定
		#01	
1	外壳试验 (IP6X) 试验要求: 1.防尘试验条件: 试品置于适当密封的试验箱内, 试验箱内盛有成悬浮状态的滑石粉。试品支承于试验箱内, 用真空泵抽气使设备壳内气压低于环境气压。抽气管接在专为试验而开的孔上。压差 2kPa。试验持续 2h。 2. 钢丝试验: 用直径为 1mm 的钢丝做试验。 判定条件: 防尘试验: 试验后壳内无灰尘进入, 则认为符合防护要求。 2. 钢丝试验: 如钢丝不能进入壳内, 则认为符合防护要求。	2h 1mm 无尘埃进入 钢丝不能进入	合格
2	外壳试验 (IPX6) 试验条件: 用标准喷嘴作试验。 喷嘴内径: 12.5mm; 水流量: 95-105L/min; 喷嘴水压: 约 100kPa; 喷嘴至外壳表面距离: 约 3m; 试验时间: 每平方米 1min, 至少 3min。 判定条件: 样品的进水量应不足以影响设备的正常操作或破坏安全性; 水不积聚在可能导致沿爬电距离引起漏电起痕的绝缘部件上; 水不进入带电部件, 或进入不允许在潮湿状态下运行的绕组; 水不积聚在电缆头附件或进入电缆。	100 100 7min 无进水	合格

—以下空白—

声 明

STATEMENT

1. 本报告（包括复制件）未加盖印章一律无效。

The test report (including its copy) without the seal shall be considered as invalid.

2. 本报告未经本实验室书面批准，不得部分复制，除非全部复制。

The test report shall not be reproduced except in full, without written approval of the laboratory.

3. 本报告无编制、审核、批准人签字无效。

The test report without the signature of the preparing person, review person and approval person shall be considered as invalid.

4. 本报告涂改无效。

Any corrections made on any parts of this test report shall be considered as invalid.

5. 检测结果只与委托检测的委托方送样样品有关。

This result is only related to the samples delivered.

6. 本机构在资质认定证书确定的能力范围内，对社会出具具有证明作用的数据、结果时，应标注检验检测资质认定标志，并加盖检验检测专用章。在资质认定证书确定的能力范围外，出具的检验检测报告或者证书上不得标注检验检测资质认定标志，该数据、结果对社会不具有证明作用。

When the laboratory issues data and results that prove the role within the scope of the qualifications determined by the qualification certificate, it shall mark the qualification certificate mark of the inspection and testing institution, and affix a special seal for inspection and testing. When the laboratory is outside the scope of the ability to determine the qualification certificate, the inspection and testing report or certificate issued shall not be marked with the qualification certificate of the inspection and testing institution. The data and results have no proof role of society.

检验单位/ Testing Laboratory:	上海电器设备检测所有限公司/Shanghai Testing & Inspection Institute for Electrical Equipment Co. Ltd.
地址/ Address:	上海市武宁路 505 号/505 Wuning Road, Shanghai, P.R. China 上海市环城北路 358 号/358 North Huancheng Road, Shanghai, P.R. China
邮编/ Postcode:	200063
电话/ Tel:	021-62574990-487 （业务接待/ Reception） 021-62574990-404 （财务/ Financial）
传真/Fax:	021-62545249 （业务接待/ Reception） 021-32255699 （财务/ Financial）
银行开户名/Bank Account Name:	上海电器科学研究所（集团）有限公司 / Shanghai Electrical Apparatus Research Institute(Group)Co.,Ltd
银行帐号/ Bank Account:	096880-215080082110001
开户银行/Bank:	招商银行上海分行曹家渡支行 / China Merchants Bank Shanghai Branch
投诉热线/tel/fax:	021-62574990-442 / 021-62435543
投诉邮箱/email:	sticc_customer@seari.com.cn